


**CAUTION:**  
 Communication cable guying (telephone and cable television) shall be secured on an anchor owned by them. Guying to an anchor owned by the electric company is not allowed.

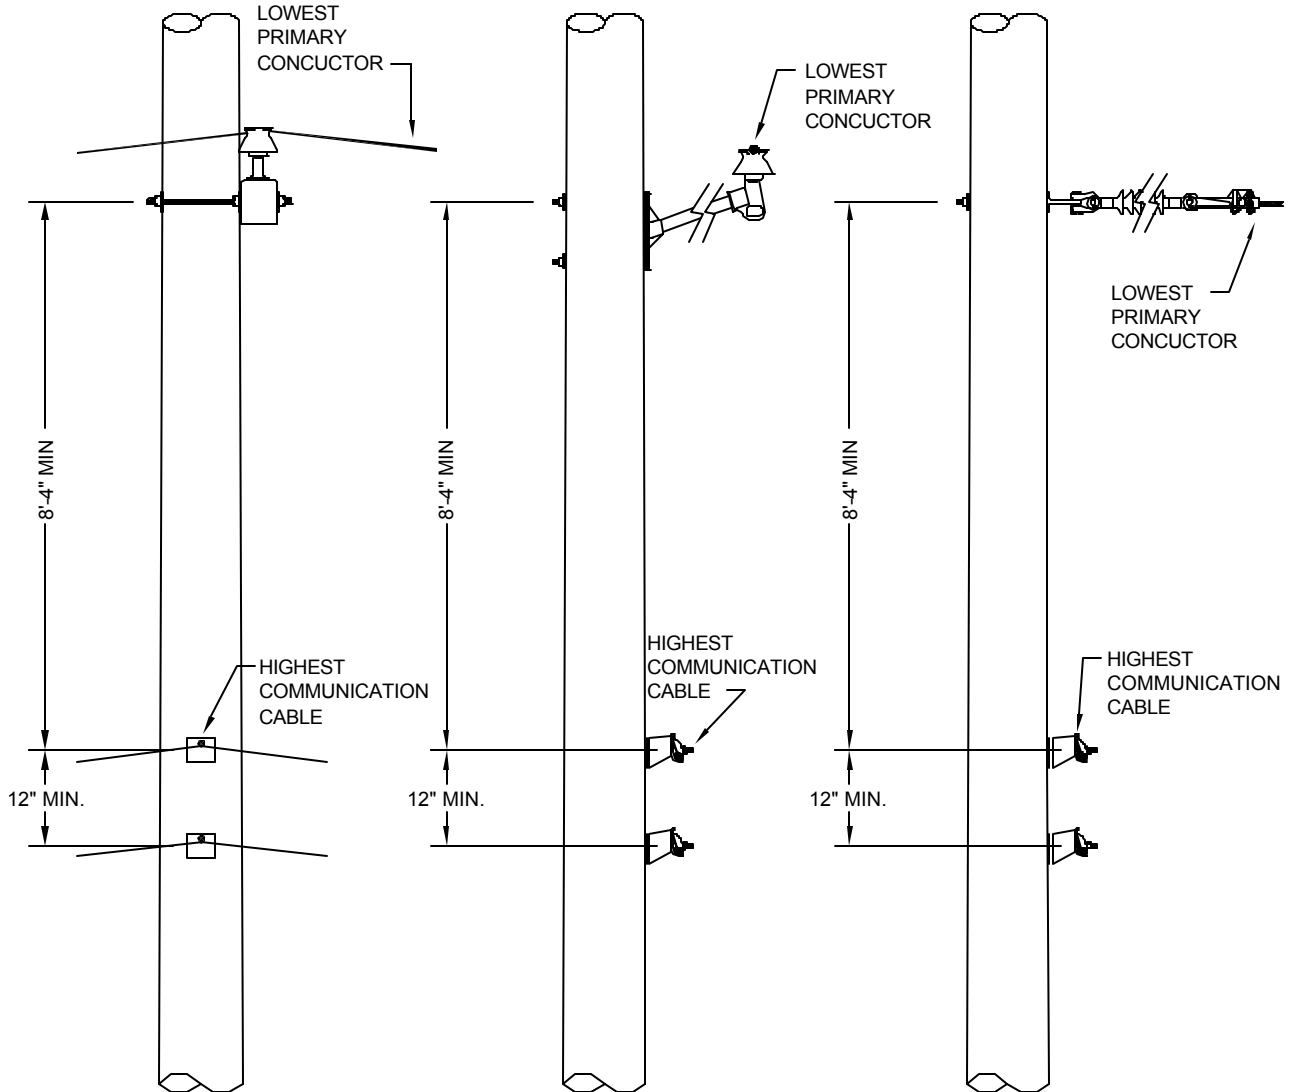

**NOTES:**

1. All communication cable attachments shall be on the same side of the pole as the lowest level electric conductor.
2. See drawings DAS03121 & DAS03131 for joint use attachment clearances for poles that contain secondary conductors or nonshielded construction (where the neutral is lower than the primary conductor).
3. See drawings DAS03141 for midspan clearances on poles that contain only primary conductors.

ENTERGY SERVICES, INC.			
<b>COMMUNICATION CABLE CLEARANCES AND REQUIREMENTS FROM PRIMARY CONDUCTOR</b>			
APPROVED BY:	JRH	DATE:	5/28/02
CHECKED BY:	RHO	SCALE:	NONE
DRAWN BY:	DAT	CEA NO.	00000
		No. <b>DAS03151</b>	
		PLOT 1=32	SH. 1 OF 1

1	1/5/11	Removed note 1 and renumbered 2-4 to 1-3	DAT	JRH
NO.	DATE:	REVISION	BY:	APPR:

