



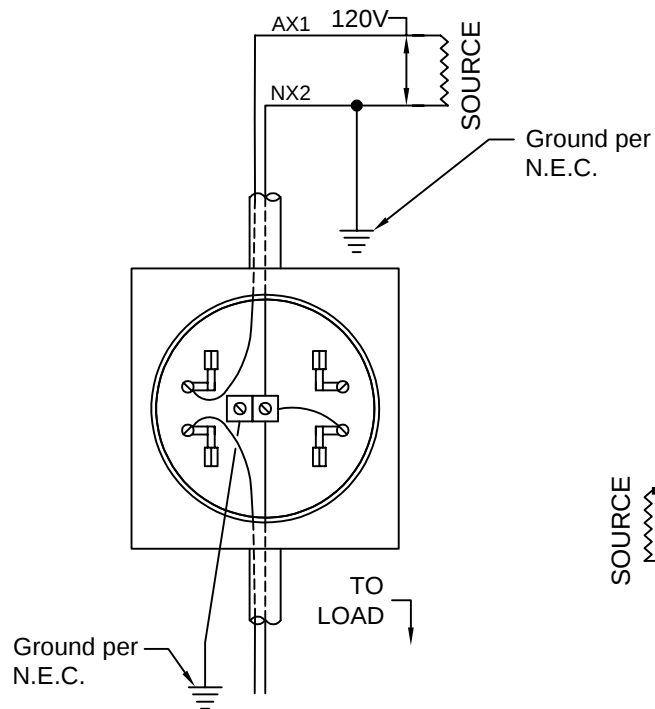

TYPE S
2 WIRE SINGLE PHASE 120 VOLTS

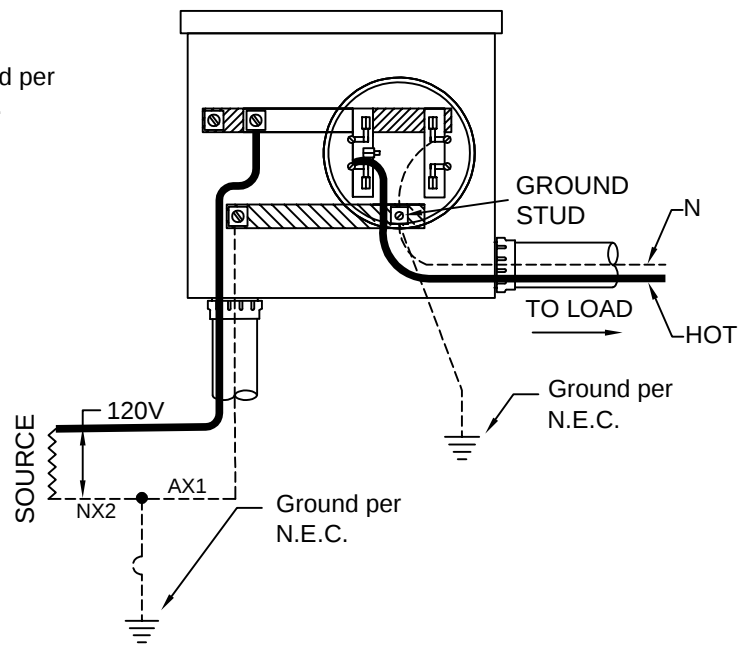

TYPE S
2 WIRE SINGLE PHASE 120 VOLTS

FOR REFERENCE ONLY:

REQUIRES PRIOR COMPANY APPROVAL

NOTES:

1. LOAD AND SUPPLY WIRES SHALL NOT CROSS IN THE METER SOCKET.
2. 100 AMPS ONLY.

3	11-3-25	REVISED PER CUSTOMER INSTALLATIONS 2025	ERG	EB
2	06/15/17	Updated title as needed	ERG	
1	04/13	NEW DRAWING	JED	
NO.	DATE:	REVISION	BY:	APPR:

ENTERGY SERVICES, INC.			
WIRING DIAGRAM CONNECTIONS FOR 120V (TWO WIRE) SELF CONTAINED METERS			
APPROVED BY:	GB	DATE:	04/03/2013
CHECKED BY:	EB	SCALE:	NONE
DRAWN BY:	krich95		
entergy		No.	D9-1
PLOT	1=1	SH.	1 OF 1