

SERVICE ENTRANCE CONDUCTORS
MINIMUM LENGTH 3'
BEYOND WEATHERHEAD

DIVISION OF OWNERSHIP
AT CONNECTOR

911 address shall be a minimum 3" lettering marked on meter enclosure, pole, or durable material attached to pole and should be visible from street. (See section 3.4)

COMPANY SERVICE CABLE

WEATHERHEAD
(SEE NOTE 3)

CONDUIT STRAP

CLEARANCE OVER ROADS, STREET, ALLEYS, AND PARKING LOTS SUBJECT TO TRUCK TRAFFIC. SEE 7-3.

5/8" EYEBOLT
RECOMMENDED

13' 6" MINIMUM
EXTRA HEIGHT MAY
BE REQUIRED TO
MAINTAIN CLEARANCE
(SEE NOTE 3)

4 RISERS MAX.

RIGID METAL CONDUIT OR EMT

LOCKNUTS

SEE DETAIL "A"

DESIGNATED HIGH VOLTAGE LEG
FOR 120V/240V DELTA SERVICE

RIGID METAL CONDUIT OR EMT

MAIN
DISC


BONDING SCREW REQUIRED

#4 CU MIN.

5'-6" FROM
GROUND LEVEL
TO CENTER OF
METER SOCKET.

24" MIN.,
6" MAX. TO
CENTER LINE OF
ENCLOSURE

5/8" X 8" COPPERWELD
GROUND ROD
IN UNDISTURBED SOIL
A SECOND GROUNDING
ELECTRODE MAY BE REQUIRED,
PER THE N.E.C.

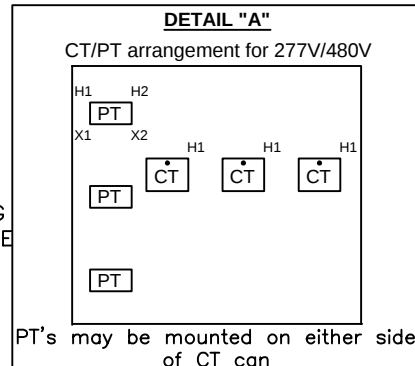

Main Disconnect: Readily accessible to Company at all hours with no notice

NOTES:

1. All material, except instrument transformers, meter, and meter socket are to be furnished, installed, and maintained by the customer in a location approved by company.
2. Instrument transformers and meter socket are to be furnished by company and installed by the customer.
3. Weather head no less than 14ft. from ground. Point of attachment of service 13'-6" ft. min. and 21 ft. max above ground.
4. Company reserves the right not to connect service if company representative considers the installation not safe or not adequate.
5. Service structure shall be as close as possible to the Company pole to which service is to be connected, not to exceed 60 ft.
6. Use masonry anchors to secure the meter arrangement (plastic anchors are not allowed).
7. Company will install, own, and maintain service connectors.
8. PT's may be mounted on either side of CT can.
9. Conductor shall be installed in conduit where exposed.
10. Single phase 120v/240v 3 wire service requires only 2 CTs.
11. All Meter Transformer enclosures shall: Have a metal or 3/4" treated plywood back-plate in addition to the back wall of the enclosure, be UL listed, be weather proof/rain-tight (NEMA 3R), have a locking mechanism to secure it suitable for a company padlock, be side hinged, be minimum Aluminum or 14 gauge G90 steel enclosure.

TABLE 9.1.3: GUIDELINE FOR METER TRANSFORMER ENCLOSURE WITH MULTIPLE CIRCUITS

Total Customer Conduits (4" min)	Maximum Conductor Size	Minimum Dimensions		
		Depth	Width	Height
Up to 4	600 kcmil	14"	32"	40"
Up to 6	500 kcmil	14"	32"	54"

CTs will be placed at center. Customer Conduit spaced evenly.
Service connections shall not be made in an instrument transformer enclosure.
For larger sizes, consult the Company.

CALL 811 TWO BUSINESS DAYS BEFORE YOU DIG

In locations with underground facilities, the Customer shall notify One Call and shall have One Call locate all underground facilities before digging. It shall be the responsibility of the Customer to stay clear of all underground facilities.

ENTERGY SERVICES, INC.

CURRENT INSTRUMENT
TRANSFORMER FOR
OVERHEAD SERVICE

APPROVED BY: JRH DATE: 11/15/2012

CHECKED BY: JED SCALE: NONE




DRAWN BY: krich95 CEA NO.

entergy No. D9-6

PLOT 1=1 SH. 1 OF 1

3	11-3-25	REVISED PER CUSTOMER INSTALLATIONS 2025	ERG	EB
2	06/15/17	Revised drawing and notes as needed.	ERG	
1	10/12	REVISION OF DRAWING SS11.8-3	JED	
NO.	DATE:	REVISION	BY:	APPR:

911 address shall be a minimum 3" lettering marked on meter enclosure, pole, or durable material attached to pole and should be visible from street. (See section 3.4)

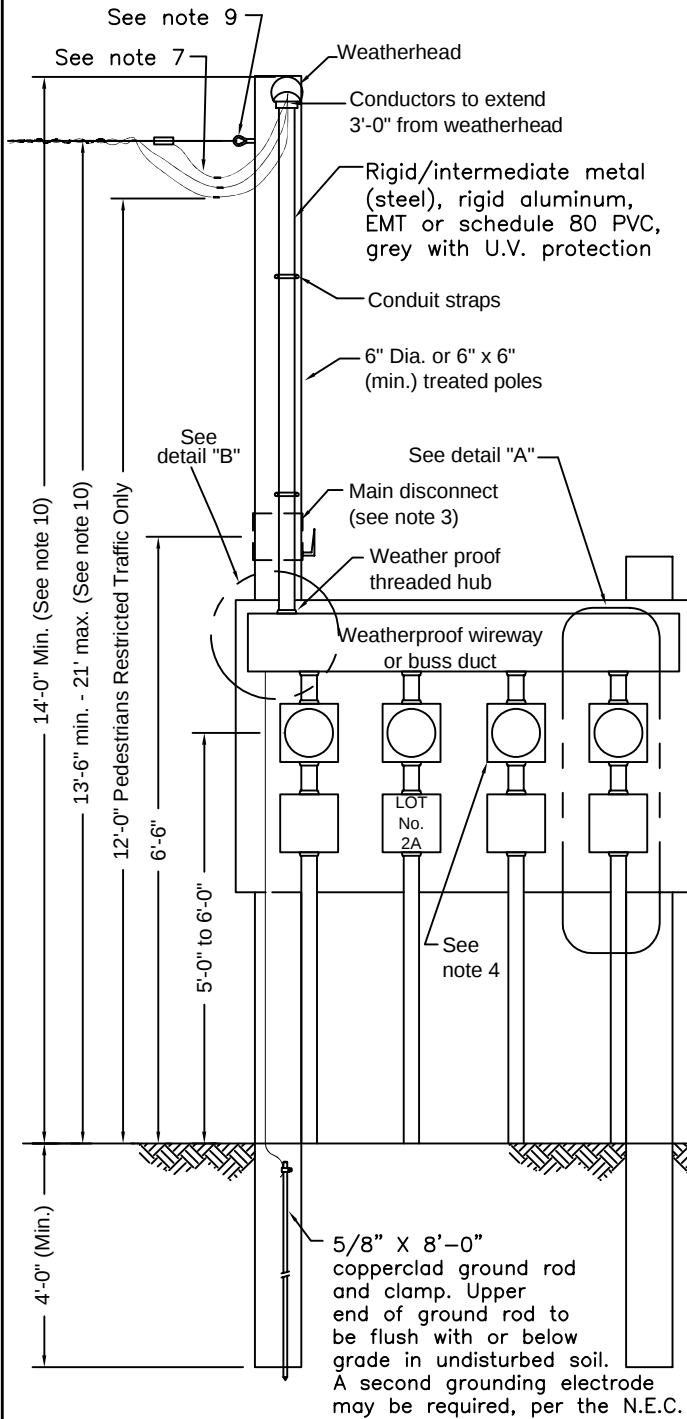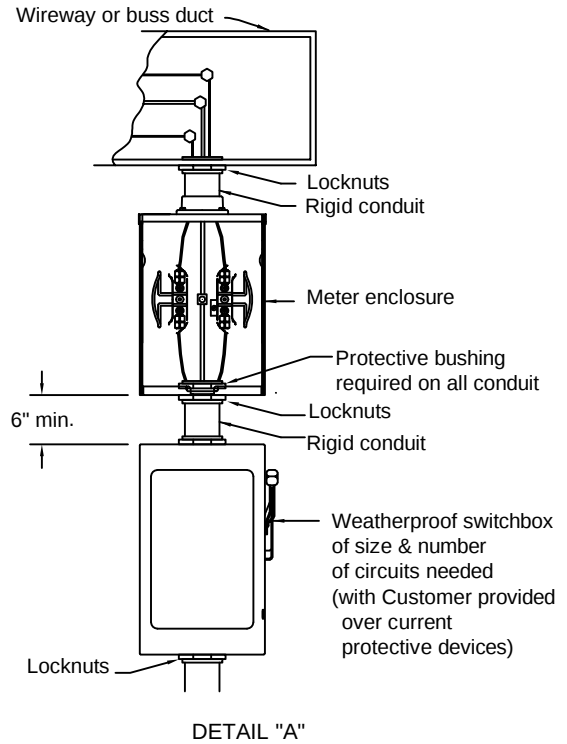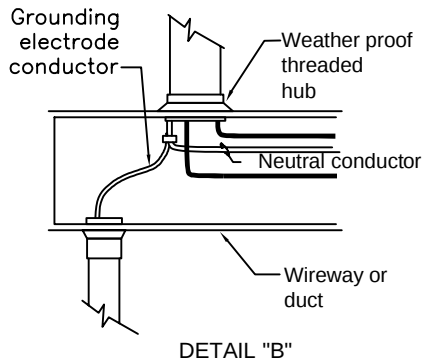

NOTES:

1. Customer facilities shall comply with Company Standards, the National Electrical Code, and authorities having jurisdiction. All material shall be suitable for outdoor use. Equipment to be installed at a location designated by the Company.
2. This installation applies to two (2) or more meters at one location.
3. A main disconnect is required for seven or more disconnects (NEC). A main disconnect is recommended in all cases for isolation of this disconnect/meter group from any other groups served by the same Company transformer.
4. For identification purposes, all meter enclosures will be plainly and permanently labeled to designate the particular apartment or office served. Each meter should have a separate cover that can be removed for repairs without disturbing other meters.
5. Consult Company in design phase to learn what Conductors Company will furnish.
6. Company installs, owns, and maintains service and service connectors. Neutral shall be marked with white tape on both ends and may be bare wire.
7. Company shall make connection at top of weatherhead only.
8. Customer installed minimum 1/2" galvanized eye bolt with 2" x 2" square washer recommended.
9. If a current transformer (CT) installation is required, see drawing D9-6.
10. Additional height may be required to maintain proper clearance per Section 7.3 clearances.

CALL 811 TWO BUSINESS DAYS BEFORE YOU DIG
In locations with underground facilities, the Customer shall notify One Call and shall have One Call locate all underground facilities before digging. It shall be the responsibility of the Customer to stay clear of all underground facilities.

ENTERGY SERVICES, INC.

CUSTOMER OWNED MULTIPLE METER
(FIELD ASSEMBLED)
OVERHEAD SERVICE

APPROVED BY: EB DATE: 01/15/2013

CHECKED BY: GB SCALE: NONE


DRAWN BY: krich95



No. D9-8

PLOT 1=1 SH. 1 OF 1

3	11-3-25	REVISED PER CUSTOMER INSTALLATIONS 2025	ERG	EB
2	06/15/17	Revised drawing and notes as needed.	ERG	
1	01/13	REVISION FOR DRAWING SS11.6-1	JED	
NO.	DATE:	REVISION	BY:	APPR:

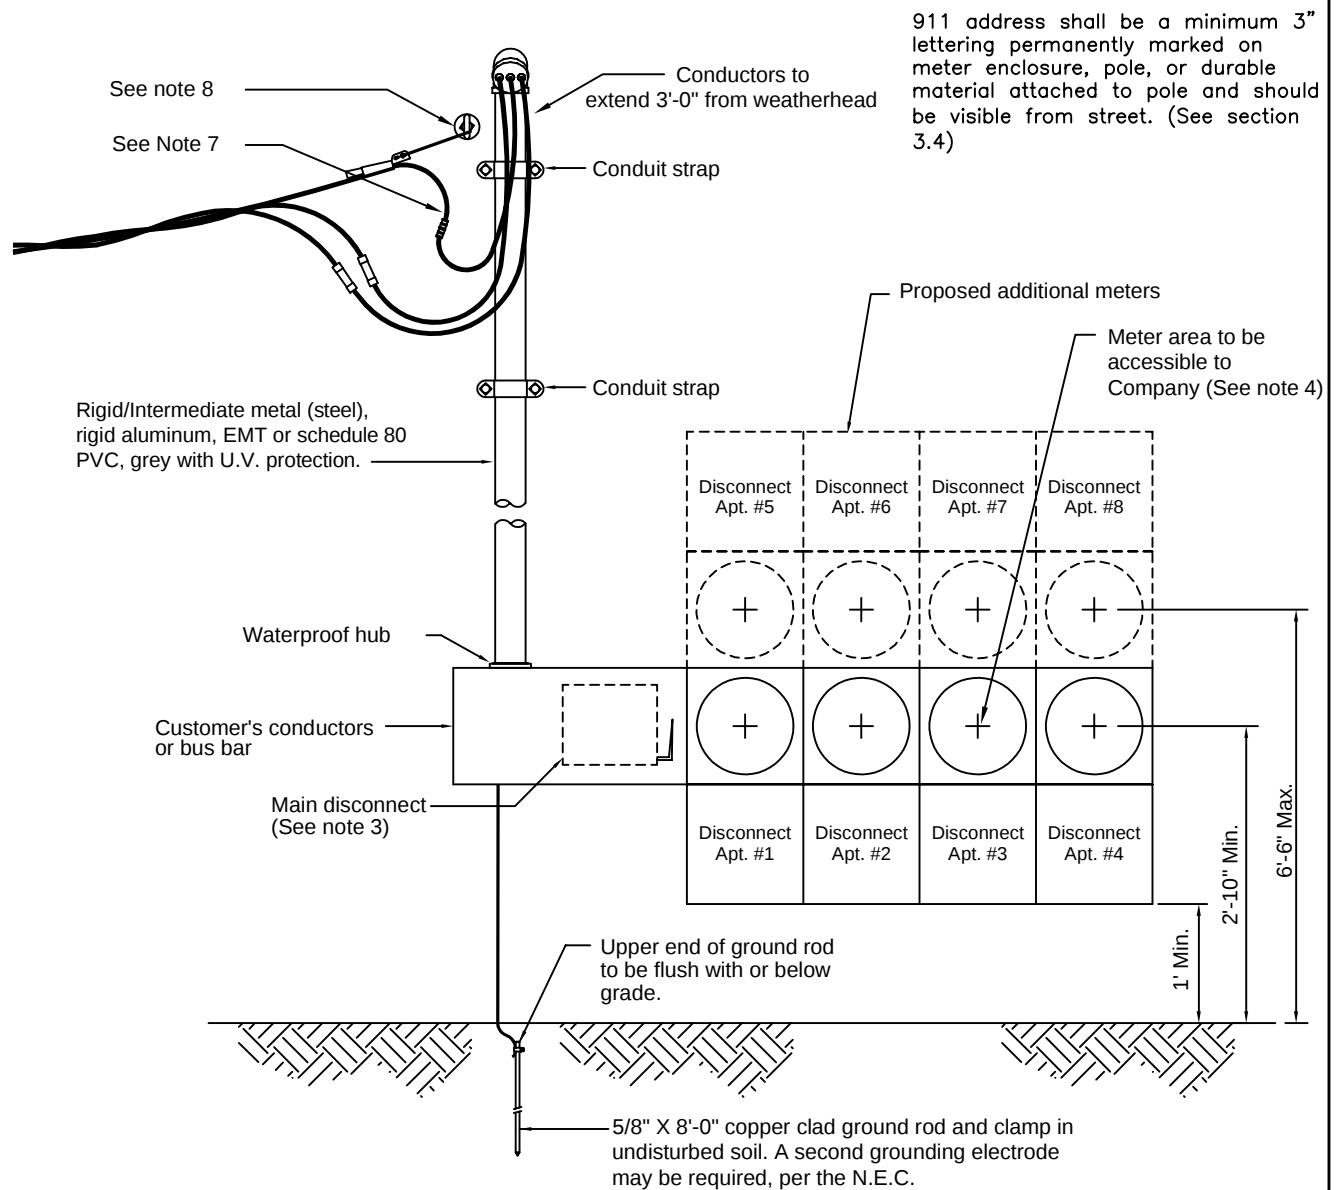

911 address shall be a minimum 3" lettering permanently marked on meter enclosure, pole, or durable material attached to pole and should be visible from street. (See section 3.4)

NOTES:

- Customer facilities shall comply with Company Standards, the National Electrical Code, and authorities having jurisdiction. All material shall be suitable for outdoor use. Equipment to be installed at a location designated by the Company.
- This installation applies to two (2) or more meters at one location.
- A main disconnect is required for seven or more disconnects (NEC). A main disconnect is recommended in all cases for isolation of this disconnect/meter group from any other groups served by the same Company transformer.
- For identification purposes all meter enclosures will be plainly and permanently labeled to designate the particular apartment or office served. Each meter should have a separate cover that can be removed for repairs without disturbing other meters.
- Consult Company in design phase to learn what Conductors Company will furnish.
- Company installs, owns, and maintains service and service connectors. Neutral shall be marked with white tape on both ends and may be bare wire.
- Company shall make connection at top of weatherhead only.
- Customer installed minimum 1/2" galvanized eye bolt with 2" x 2" square washer recommended.
- If a current transformer (CT) installation is required, see drawing D9-6.

CALL 811 TWO BUSINESS DAYS BEFORE YOU DIG

In locations with underground facilities, the Customer shall notify One Call and shall have One Call locate all underground facilities before digging. It shall be the responsibility of the Customer to stay clear of all underground facilities.

ENTERGY SERVICES, INC.

**CUSTOMER OWNED MULTIPLE METER
(PRE-ASSEMBLED)
OVERHEAD SERVICE**

APPROVED BY: GB DATE: 01/15/2013

CHECKED BY: EB SCALE: NONE

DRAWN BY: krich95



No. D9-9

PLOT 1=1 SH. 1 OF 1

3	11-3-25	REVISED PER CUSTOMER INSTALLATIONS 2025	ERG	EB
2	06/15/17	Revised notes as needed	ERG	
1	01/13	REVISION FOR DRAWING SS11.6-2	JED	
NO.	DATE:	REVISION	BY:	APPR: