


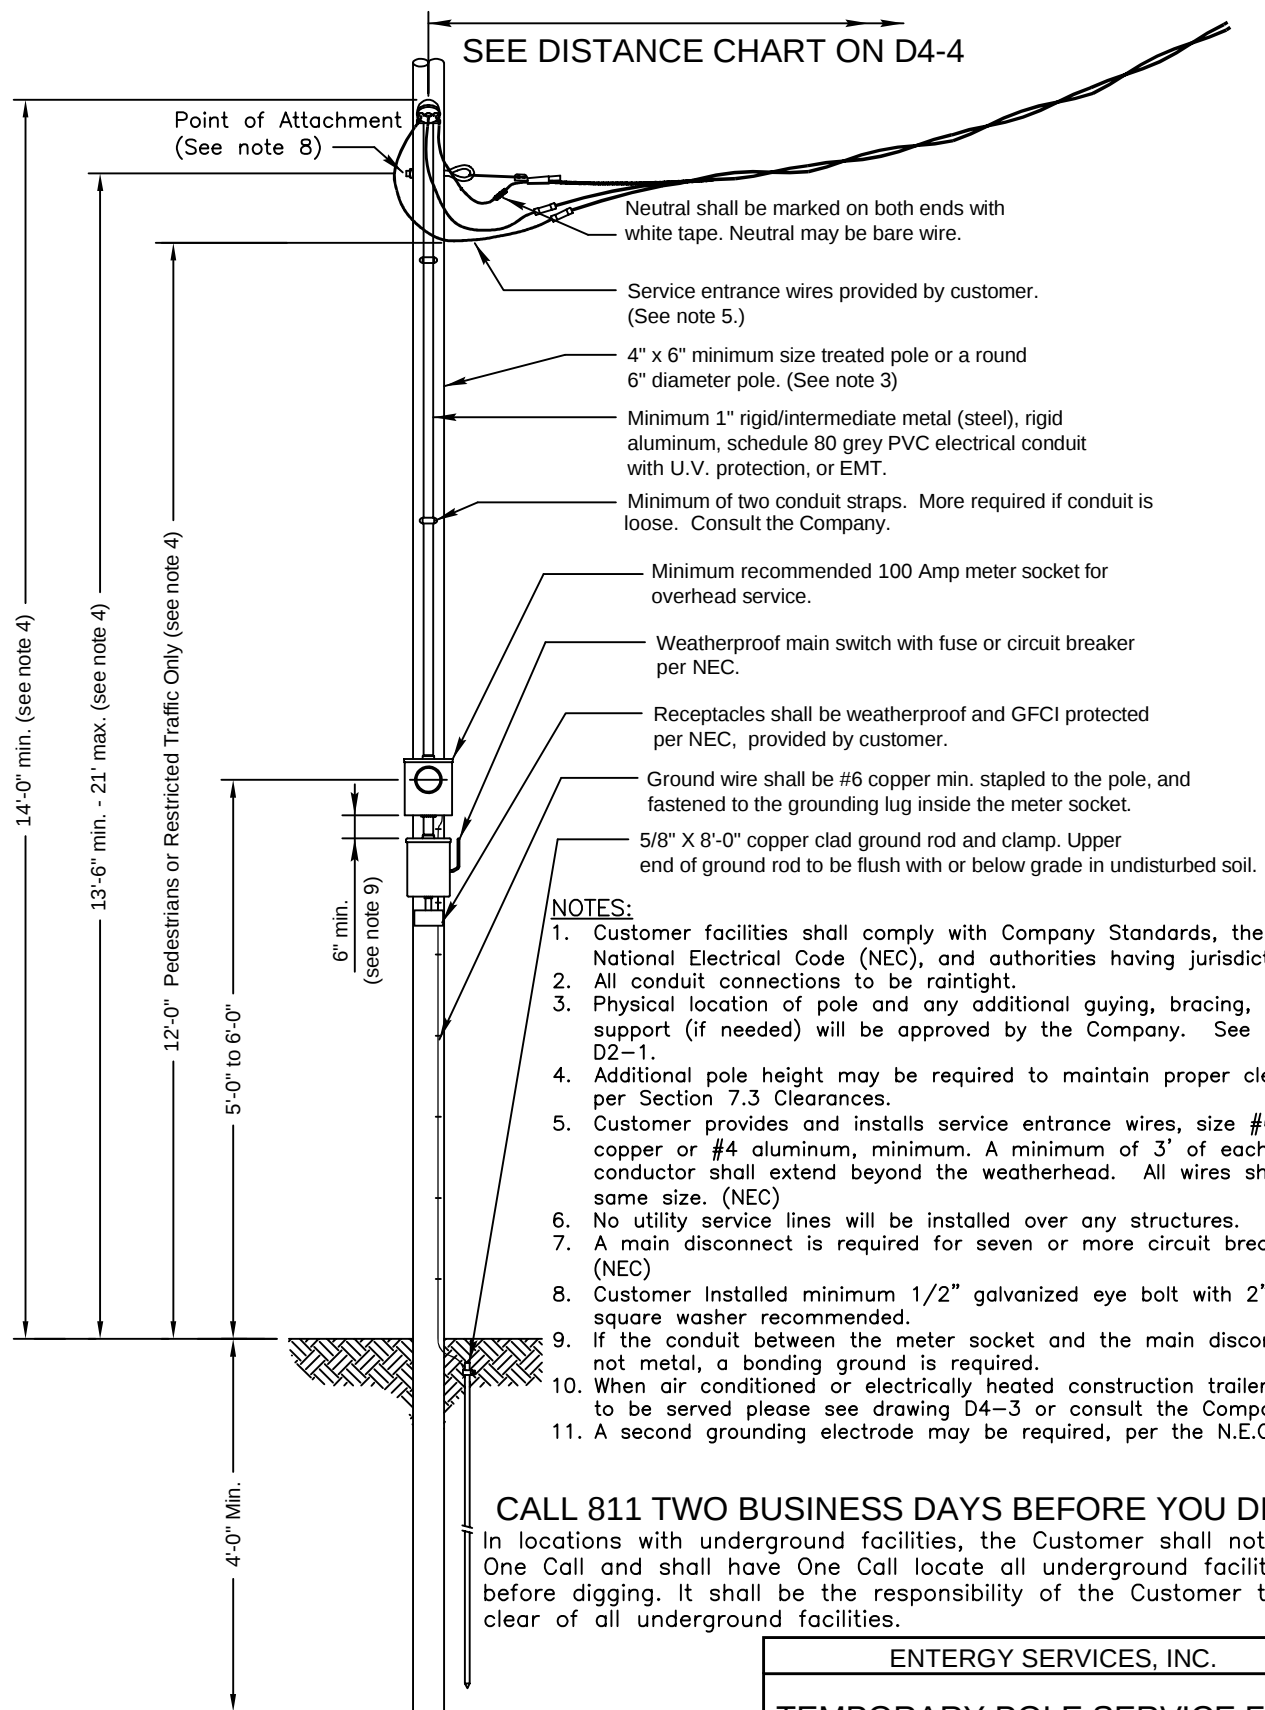

CALL 811 TWO BUSINESS DAYS BEFORE YOU DIG

In locations with underground facilities, the Customer shall notify One Call and shall have One Call locate all underground facilities before digging. It shall be the responsibility of the Customer to stay clear of all underground facilities.

911 address shall be a minimum 3" lettering permanently marked on meter enclosure, pole, or durable material attached to pole and should be visible from street. (See section 3.4)


3	11-3-25	REVISED PER CUSTOMER INSTALLATIONS 2025	ERG	EB
2	06/15/17	ADDED POLE DEPTH DIMENSION	ERG	
1	01/13	REVISION OF DRAWING SS4.5-1	JED	
NO.	DATE:	REVISION	BY:	APPR:

ENTERGY SERVICES, INC.


TEMPORARY POLE SERVICE FROM AN OVERHEAD SOURCE

APPROVED BY:	GB	DATE:	01/10/2013
CHECKED BY:	EB	SCALE:	None
DRAWN BY:	krich95		

	No. D4-1	
	PLOT 1=1	SH. 1 OF 1

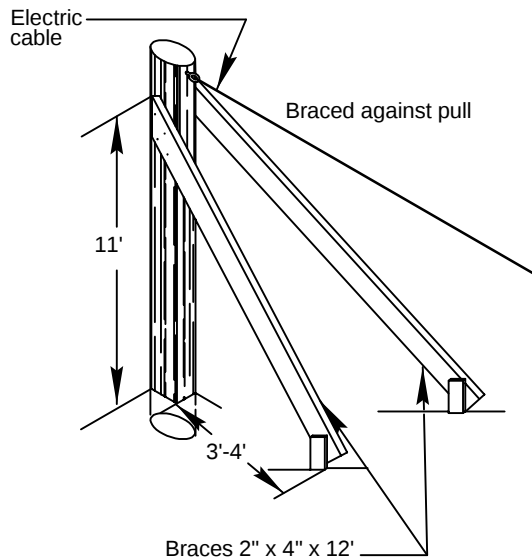

POLE

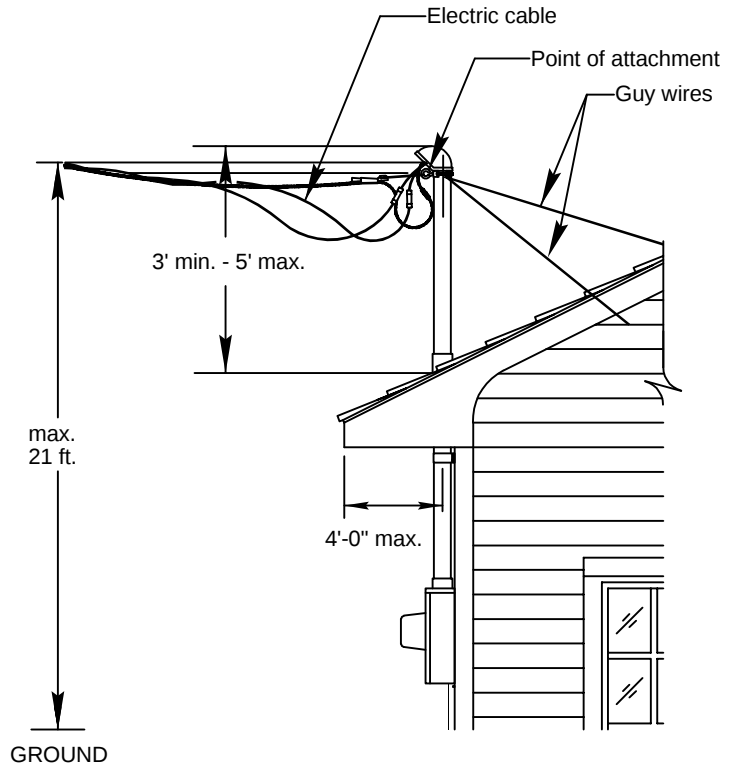

MAST ABOVE ROOF

CALL 811 TWO BUSINESS
DAYS
BEFORE YOU DIG

In locations with underground facilities, the Customer shall notify One Call and shall have One Call locate all underground facilities before digging. It shall be the responsibility of the Customer to stay clear of all underground facilities.

ENTERGY SERVICES, INC.

BRACING

APPROVED BY: GB	DATE: 02/26/2013
CHECKED BY: EB	SCALE: None
DRAWN BY: krich95	

NOTES:

1. Bracing is required if a pole or riser is unstable, deflects, bends, or moves when shaken or a ladder is put against it or bends when wires are attached.

2. Consult the Company for specific requirements.

2	11-3-25	REVISED PER CUSTOMER INSTALLATIONS 2025	ERG	GB
1	02/13	THIS DRAWING ADDED-NEW	JED	
NO.	DATE:	REVISION	BY:	APPR:




No. D2-1

PLOT 1=1 SH. 1 OF 1

911 address shall be a minimum 3" lettering permanently marked on meter enclosure, pole, or durable material attached to pole and should be visible from street. (See section 3.4)

Shall meet requirements of drawings D4-4 and D9-2.

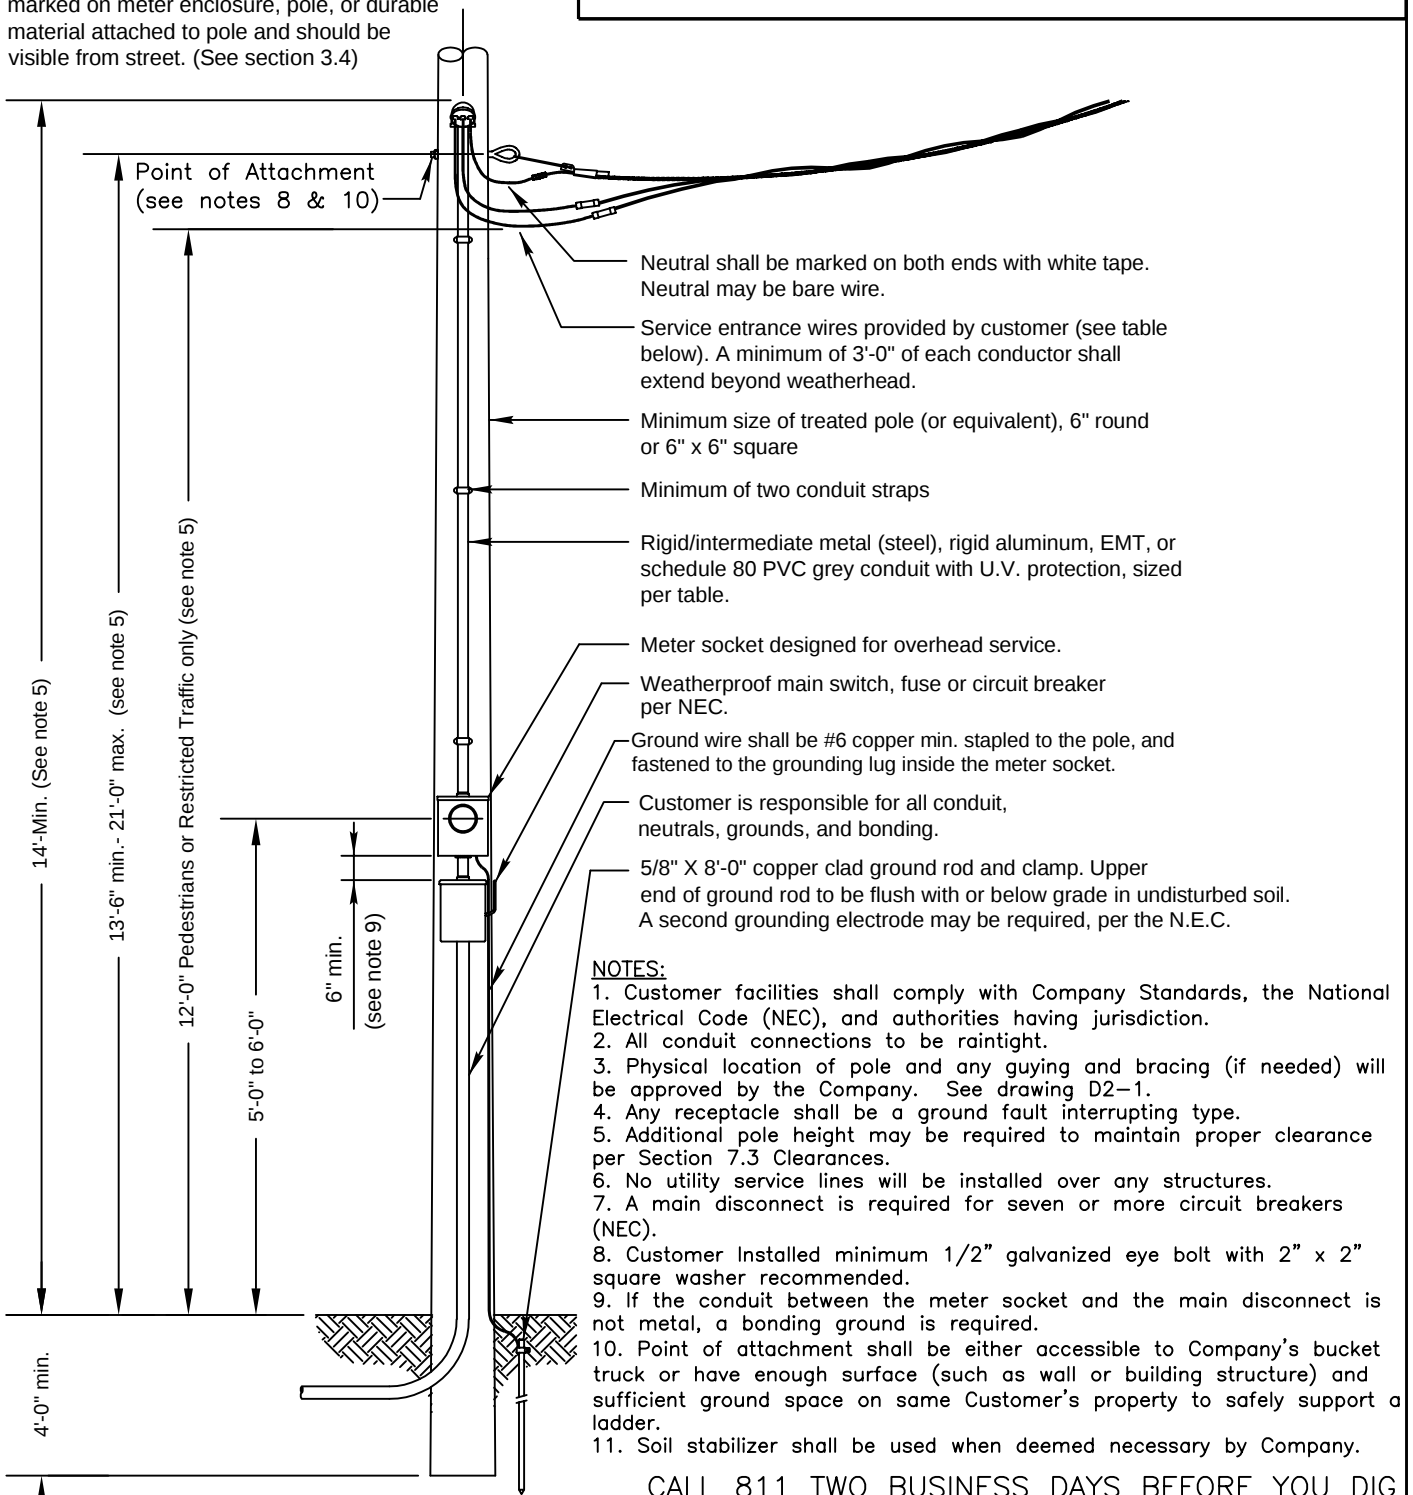

CALL 811 TWO BUSINESS DAYS BEFORE YOU DIG
In locations with underground facilities, the Customer shall notify One Call and shall have One Call locate all underground facilities before digging. It shall be the responsibility of the Customer to stay clear of all underground facilities.

Minimum Customer Wiring Size - Residence Single Phase **				
METER SIZE	CONDUIT SIZE	Current carrying & neutral wire size (per NEC) *		COPPER GROUND WIRE SIZE**
		ALUMINUM	COPPER	
100 Amp	1.5"	#2	#4	#6 *
200 Amp	2"	4/0	2/0	#4
320 Amp	3"	500	350	#2

* Wire sizes based upon customer breaker size

** For 3Ø, consult the company Commercial & Industrial. Wire sizes are typically larger.

ENTERGY SERVICES, INC.

SERVICE TO PERMANENT POLE
LOCATION FROM AN OVERHEAD SOURCE
(EXAMPLE MOBILE HOMES)

APPROVED BY: GB DATE: 01/09/2013

CHECKED BY: EB SCALE: None

DRAWN BY: krich95



No. D4-3

PLOT 1=1 SH. 1 OF 1

3	11-3-25	Revised per customer installations 2025	ERG	EB
2	06/15/17	Revised dimensions and added note 11.	ERG	
1	01/13	REVISION OF DRAWING SS4.6-1	JED	
NO.	DATE:	REVISION	BY:	APPR: